



PV-solar / wind hybrid energy system for GSM/CDMA type mobile telephony base station

Pragya Nema¹, R.K. Nema², Saroj Rangnekar¹

¹ Energy Engineering Department, Maulana Azad National Institute of Technology , Bhopal-462007
M.P., India.

² Electrical Engineering Department, , Maulana Azad National Institute of Technology , Bhopal-462007
M.P., India.

Abstract

This paper gives the design idea of optimized PV-Solar and Wind Hybrid Energy System for GSM/CDMA type mobile base station over conventional diesel generator for a particular site in central India (Bhopal) . For this hybrid system ,the meteorological data of Solar Insolation, hourly wind speed, are taken for Bhopal-Central India (Longitude 77°.23'and Latitude 23°.21') and the pattern of load consumption of mobile base station are studied and suitably modeled for optimization of the hybrid energy system using HOMER software. The simulation and optimization result gives the best optimized sizing of wind turbine and solar array with diesel generator for particular GSM/CDMA type mobile telephony base station. This system is more cost effective and environmental friendly over the conventional diesel generator. It should reduced approximate 70%-80% fuel cost over conventional diesel generator and also reduced the emission of CO₂ and other harmful gasses in environments. It is expected that the newly developed and installed system will provide very good opportunities for telecom sector in near future.

Copyright © 2010 International Energy and Environment Foundation - All rights reserved.

Keywords: Hybrid energy systems, Mobile telephony base station, Wind turbine, PV-solar, Optimization.

1. Introduction

Obtaining reliable and cost effective power solutions for the worldwide expansion of telecommunications into rural and remote areas presents a very challenging problem. Grids are either not available or their extensions can be extremely costly in remote area. Although initial costs are low, powering these sites with generators require significant maintenance, high fuel consumption and delivery costs due to hike in fuel prices.

A sustainable alternative to power remote base station sites is to use renewable energy sources. Recent research and development of Renewable energy sources[1] have shown excellent potential as a form of contribution to conventional power generation systems. In order to meet sustained load demands of mobile base station during varying natural conditions, different energy sources and converters need to be integrated with each other for extended usage of alternative energyFor Indian remote location, one of the most alternative solution .[2] of renewable energy sources such as wind-solar Hybrid Energy System for mobile base station. The use of the stand-alone solar-wind with diesel backup system for the power

supply of remote areas may give an economically attractive alternative[3] for mobile telecom sector over the use of conventional diesel generators in near future. This paper gives the design idea of wind, solar-photovoltaic hybrid energy system.

Based on the energy consumption of mobile base station and the availability of renewable energy sources, it was decided to implement an innovative stand alone Hybrid Energy System [4] combining small wind turbine-generator, solar photo-voltaic panels, battery storage, advance power electronic equipment and existing diesel generators. The system architecture employed in the hybrid system is AC-coupled where the renewable energy sources[5] and the conventional diesel generators[6] all feed into the AC side of the network as shown in Figure1.

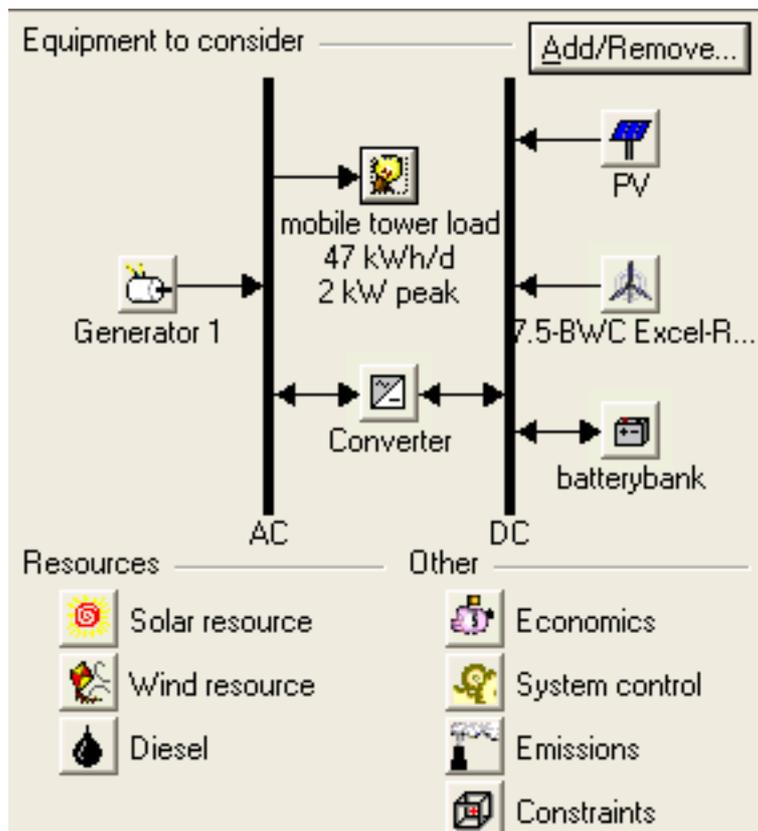


Figure 1. Hybrid system schematic diagram for mobile telephony base station

National Renewable Energy Laboratory (NREL)'s, Hybrid Optimization Model for Electric Renewable (HOMER version 2.19) [14] has been used as the sizing and optimization software tool [10]. It contains a number of energy component models and evaluates suitable technology options based on cost and availability of resources. In this paper the system sizing [7-9] is carried out using HOMER-optimization and simulation software tool. Analysis with HOMER requires information on resources, economic constraints, and control methods. It also requires inputs on component types, their numbers, costs, efficiency, longevity, etc. Sensitivity analysis could be done with variables having a range of values instead of a specific number.

2. Renewable energy resources for hybrid system

The availability of renewable energy resources at mobile base station sites is an important factor to develop the hybrid system. Many parts of the India wind and solar energy is abundantly available[11]. These energy sources are intermittent and naturally available, due to these factors our first choice to power the mobile base station will be renewable energy sources such as wind and solar. Weather data are an important factor for pre-feasibility study[12-13] of renewable hybrid energy system for any particular site. Here the Wind and Solar energy resources data are taken from NASA[15] for Bhopal-Central India (Longitude 77° 23' and Latitude 23° 21') and shown in Table 1. In central India wind speed is an average and sun brightness is strong.

Table 1. Weather data for the site

Month	Insolation (kWh/m ²)	Wind Velocity m/s
January	4.880	3.350
February	5.672	3.890
March	6.325	3.395
April	6.666	3.885
May	6.876	4.956
June	5.632	5.176
July	4.021	4.796
August	4.155	4.376
September	5.112	3.666
October	5.605	3.600
November	5.123	3.500
December	4.664	3.420
Average	5.389	4.001
Maximum	6.876	5.176
Minimum	4.021	3.350

2.1 Solar energy resource

Hourly solar irradiation data for the year was collected from Environment Bhopal. Scaling was done on these data to consider the long-term average annual resource (5.389kW h/m²/d). The clearness index for the latitude and Average daily radiation in a year is shown in Figure 2 (i). According to solar radiation, PV-power output are available throughout the year is shown in Figure 2 (ii). In summer solar power is higher than winter season. In rainy season clearness index and solar power availability is lower than summer and winter season.

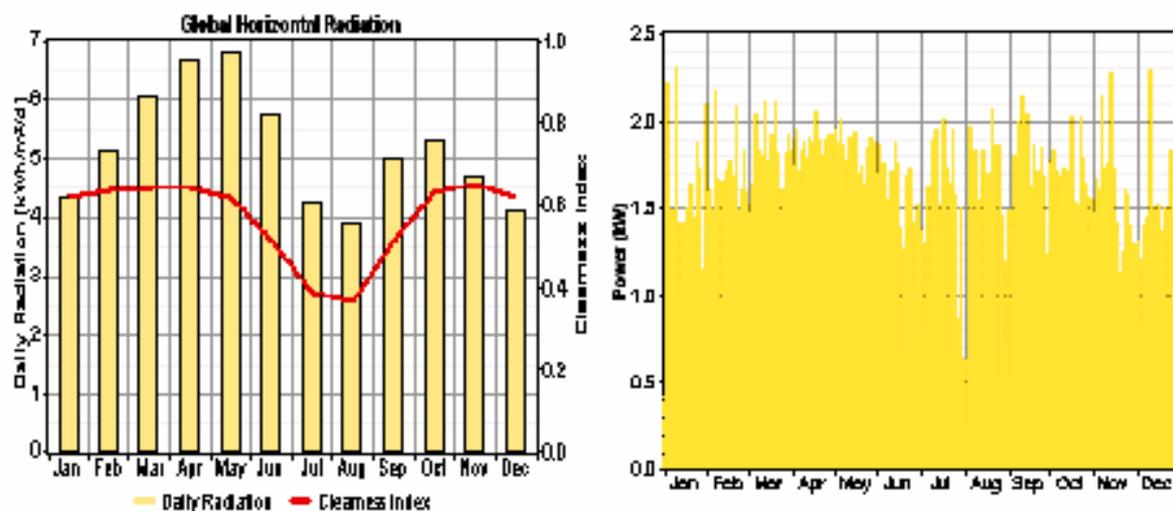


Figure 2. (i) Average daily radiation in a year, and (ii) PV-Power available throughout the year

2.2 Wind energy resource

A monthly average wind dataset for Bhopal was collected from Environment Bhopal climate. This is an average of last ten year and indicates that annual average wind speed and shown in Figure 3. From the above given data, wind speed probability function and average hourly wind speed throughout the year is shown in Figure 3.

The autocorrelation factor (randomness in wind speed) is found to be 0.85. The diurnal pattern strength (wind speed variation over a day) is 0.25 and the hours of peak wind speed is 15. Average wind speed in the summer season is slightly higher than the winter season as shown in Figure 3 (i). The power output throughout the year according to wind speed is shown in Figure 3 (ii).

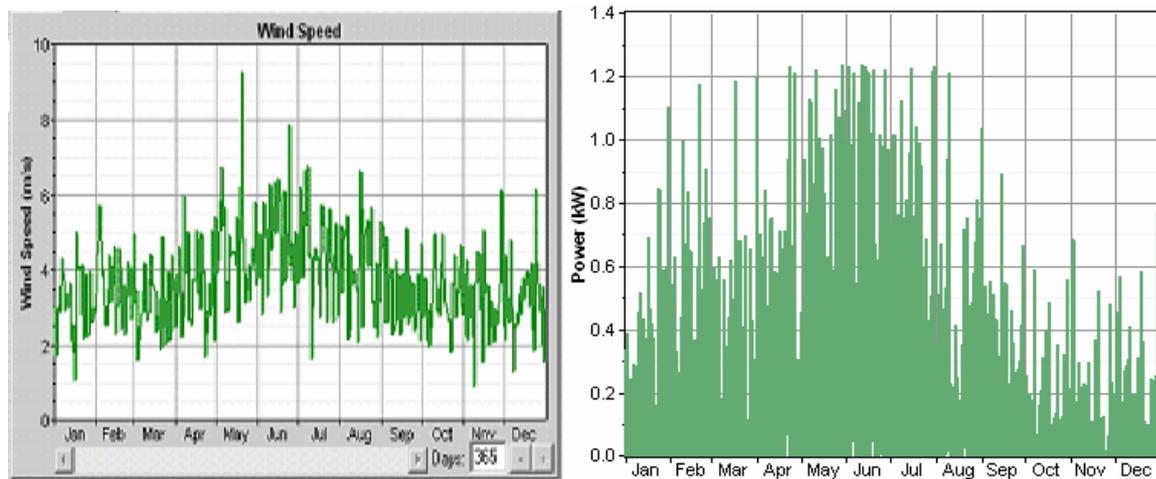


Figure 3. (i) Average hourly wind speed for 1 year, and (ii) wind power output throughout the year

3. Load pattern for mobile telephony base station

Cellular telephone service is a rapidly expanding and very competitive business world over including developed and developing countries like India, America, European countries etc. Right now there are 55,000 different type base stations for telecom sector in India and most of them running on diesel generators. But diesel generators are often expensive to run and more than one diesel generator are installed for uninterrupted service. The different types of telecom base station are used according to the technological advancement in telecommunication sector.

Recently the GSM 2/2/2 (2nd Generation Global System Mobile telephony base station) are used in all over the world. For pre-feasibility study of designing the solar wind hybrid system considered the 2nd Generation GSM base station. In this present study consider the power requirements for GSM telephony base station site are about 2kW continuous. The load demand is approximate 47kWh/d and 2 kW peak.

4. Hybrid energy system components

The proposed hybrid system consists of the following:

4.1 A 7.5 kW Wind turbine


Two 7.5kW horizontal-axes, BWC-EXCEL-R/48 type [14] wind electric generators are taken for this system. It converts wind energy into electrical energy. Availability of energy from the wind turbine depends greatly on wind variations. Therefore, wind turbine rating is generally much higher compared to the average electrical load. In this analysis, Wind Power's BWCEXcel-R/48 model is considered. It has a rated capacity of 7.5 kW and provides 48 V DC. As outputs Cost of one unit is considered to be \$15500 while replacement and maintenance costs are taken as \$12000 and \$75/year. The cost analysis is shown in Figure 4 (i). The power curves of wind turbine are shown in Figure 4 (ii). To allow the simulation program find an optimum solution, lifetime of a turbine is taken to be 20 years.

4.2 A 5 kW Photovoltaic array


Solar PV modules are connected in series parallel. When the sunrays strike the Solar PV panels, it produces electricity. The Solar PV power at the site is higher than the wind power. The installation cost of PV arrays may vary from \$5.00 to \$8.00/W considering a more optimistic case [1]. A 1 kW solar energy system's installation, and replacement costs are taken approximate as \$5000 and \$3000, respectively (Figure 5). The lifetime of the PV arrays are taken as 20 years and no tracking system is included in the PV.

4.3 Battery bank

A battery bank is used as a backup system and it also maintains constant voltage across the load. The battery pack consists of 8(6), 48V, 305Ah, 1.83kWh batteries connected in series / parallel configuration, two parallel sets of 8 batteries in series. Cost of one battery is \$520 with a replacement cost of \$370 (Figure 6). The battery stack may contain a number of batteries are 8, and 16.

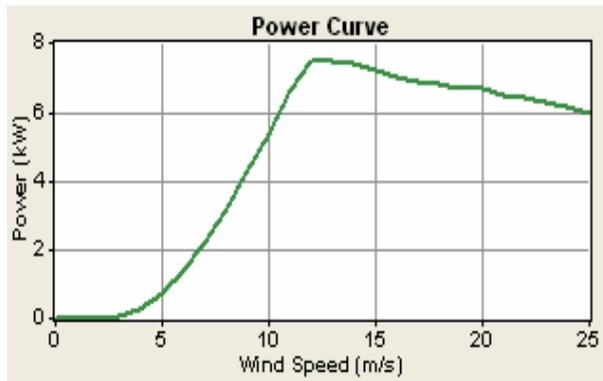

(i)

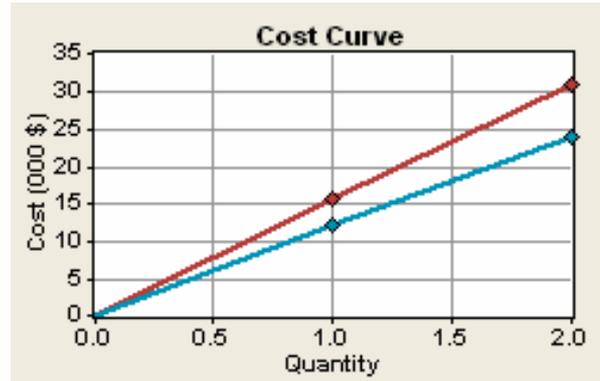

(ii)

Figure 4. A 7.5BWC-Excel R/48 (i) power curve, and (ii) cost curve

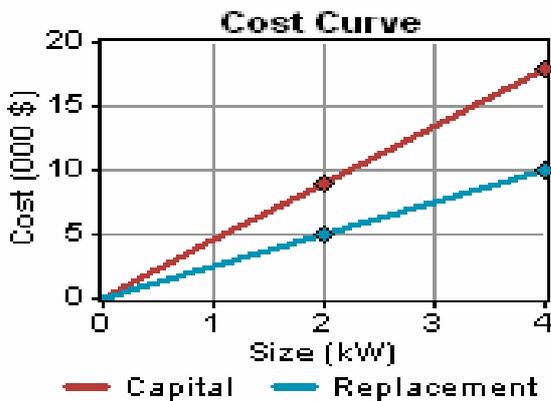


Figure 5. Cost curve of PV

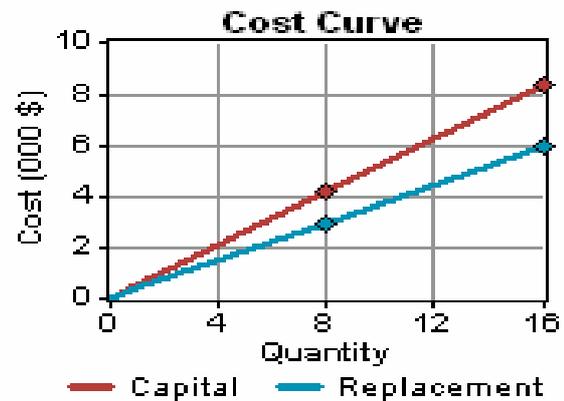


Figure 6. Cost curve of battery

4.4 Converter

A power electronic converter is needed to maintain flow of energy between the ac and dc components. For a 1 kW system the installation and replacement costs are taken as \$720 and \$460, respectively. Cost analysis shown in Figure 7. Lifetime of a unit is considered to be 15 years with an efficiency of 90%. Consider for this hybrid system 6kW converter.

4.5 Diesel generator

The fuel consumption per year is approximate 1300 Litter for 1kW Diesel Generator. The 1 kW diesel generator capital cost, replacement cost, operation-maintenance cost are 400\$, 300\$, 0.75\$. The Diesel price is used for sensitivity analysis and three discrete values (0.8, 0.85, and 0.9 \$/L) were introduced. At present, diesel price is around 0.85\$/L and for a very remote location this could increase up to 0.9\$/L. Sizes to be consider for obtaining optimal hybrid system are 2kW and 5kW .This analysis shown in Figure 8.

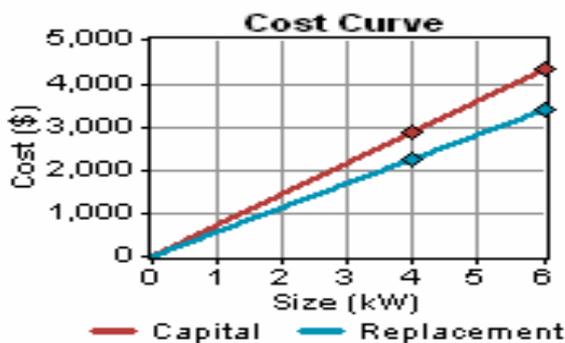


Figure 7. Cost curve of converter

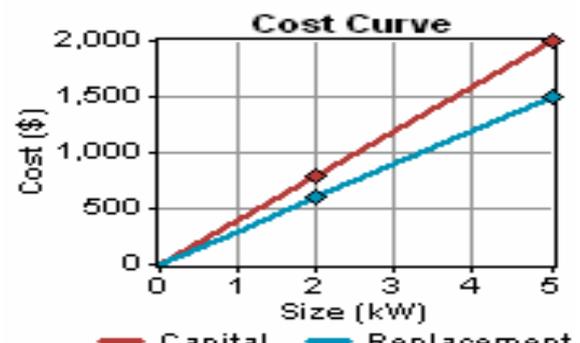


Figure 8. Cost curve of diesel generator

5. Results and discussion

The above proposed hybrid system supply the power to the mobile telephony base station continuously throughout the year. For the analysis of this hybrid system consider four sensitivity variables (wind speed, solar irradiation, fuel cost and Battery cost). For each of the sensitivity values simulate all the systems in their respective. An hourly time series simulation for every possible system type and configuration is done for a 1-year period. An optimal system is defined as a solution for hybrid system configuration that is capable of meeting the load demand of telephony base station.

5.1 Optimization results

From the simulation result the installation of wind solar hybrid system configuration for various locations are most suitable power solutions for telecom base station network in Indian sites. Considering present cost analysis of a PV/Wind hybrid system is suitable for stand-alone loads around Bhopal. From the optimization results the best optimal combination of energy system components are two 7.5kW BWC-Excel-R/48, 2 kW PV-Array and 2 kW diesel Generator.

Total net present cost (NPC), Capital cost and cost of energy (COE) for such a system is \$207,538, \$53,440 and 0.942\$/kWh, respectively for one year. The detailed optimization results are shown in Figure 9.

5.2 Simulation results

In this simulation results eliminates all infeasible combinations and ranks the feasible systems according to increasing net present cost. It also allows a number of parameters to be displayed against the sensitivity variables for identifying an optimal system type. The Monthly Average Electricity Production of Hybrid Energy System for mobile telephony base station is shown in Figure 10. In this system the total production of electrical energy is fulfil the load demand by the combination of 13% PV, 56%wind and rest of 31% by generators.

	PV (kW)	XLR	Gen1 (kW)	batteryb...	Conv. (kW)	Initial Capital	Operating Cost (\$/yr)	Total NPC	COE (\$/kWh)	Ren. Frac.
	2	2	2	16	6	\$ 53,440	12,055	\$ 207,538	0.942	0.69
	2	2	2	8	6	\$ 49,280	12,442	\$ 208,328	0.946	0.68
	2	2	2	16	8	\$ 54,880	12,114	\$ 209,741	0.952	0.69
	2	2	2	8	8	\$ 50,720	12,502	\$ 210,532	0.956	0.68
	4	2	2	16	6	\$ 62,440	11,692	\$ 211,908	0.962	0.77
	2	1	2	8	6	\$ 33,780	13,941	\$ 211,999	0.963	0.51
	4	2	2	8	6	\$ 58,280	12,068	\$ 212,545	0.965	0.75
	4	2	2	16	8	\$ 63,880	11,752	\$ 214,112	0.972	0.77
	2	1	2	8	8	\$ 35,220	14,001	\$ 214,203	0.973	0.51
	2	1	2	16	6	\$ 37,940	13,802	\$ 214,378	0.973	0.51
	4	2	2	8	8	\$ 59,720	12,127	\$ 214,749	0.975	0.75
	4	1	2	8	6	\$ 42,780	13,525	\$ 215,672	0.979	0.62
	2	1	2	16	8	\$ 39,380	13,862	\$ 216,582	0.983	0.51
	4	1	2	8	8	\$ 44,220	13,585	\$ 217,876	0.989	0.62
	4	1	2	16	6	\$ 46,940	13,373	\$ 217,886	0.989	0.64
	4	1	2	16	8	\$ 48,380	13,432	\$ 220,089	0.999	0.64
	4	2	5	16	6	\$ 63,640	17,403	\$ 286,114	1.299	0.74
	4	2	5	16	8	\$ 65,080	17,463	\$ 288,317	1.309	0.74
	2	2	5	16	6	\$ 54,640	18,948	\$ 296,860	1.348	0.66
	2	2	5	16	8	\$ 56,080	19,008	\$ 299,064	1.358	0.66

Figure 9. Optimization results of hybrid energy system for mobile telephony base station

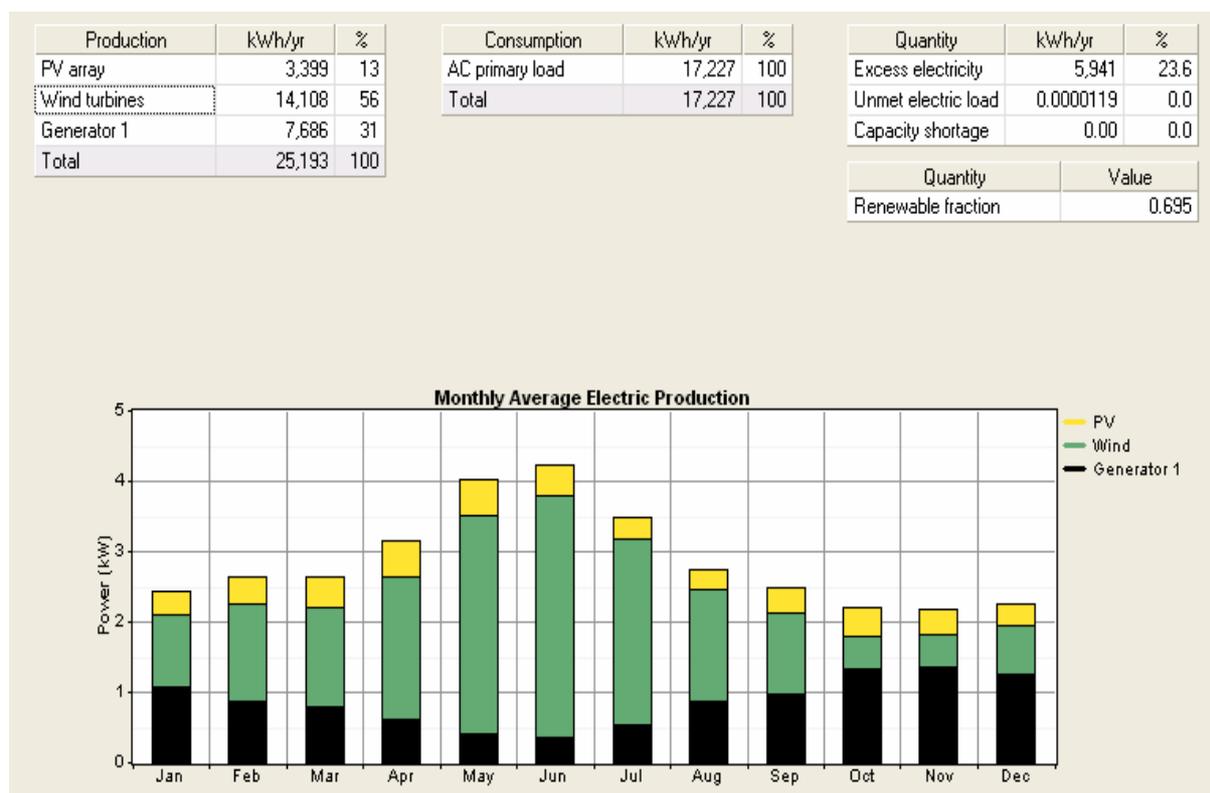


Figure10. Annual electricity production by different hybrid system

6. Conclusion

In India more than 1 billion peoples are mobile user. To provide better network services mobile operator installed new mobile base stations. Power is main issue for remote or isolated areas base station, because grid extension is not feasible. In these sites the above proposed renewable base hybrid system is most viable solution. These solutions of power supply to the telecom base station are cost effective and available throughout the year. The circumstance of each sites are studied in order to decide the feasible combination of alternative energy resources. Alternate power solutions are not commonly used in mobile telecommunication system today but are actively evaluated for remote and isolated areas over worldwide. With the help of above pre-feasibility study the solar and wind hybrid energy system are most viable power solution for mobile base station in Indian sites over conventional diesel generator. Although the net present cost is high but the running and maintenance cost are low as compared to the diesel generator power solution. Its payback time is around 15 years.

The fuel consumption is also reduced to approximate 80%.with increasing oil prices, payback times on the investment to hybrid solar-wind powered base station sites are continuously decreasing. Considering operating cost and maintenance cost, an autonomous site powered by wind solar hybrid system pay-off after 2-4 years in a good sunny and windy location. The Base stations powered by the solar wind hybrid energy system with diesel backup – are proving to be the most environmentally friendly and cost-effective solutions for many challenging sites. Operating and maintenance costs are extremely low, making it economical to extend cellular coverage in far-flung regions.

Solar- and wind-powered sites benefit the environment as well as the operator business case, whether they are located in highly populated or remote areas. Due to powering the base station by hybrid renewable energy system, it will reduce the carbon and other harmful gases emission is about 90% in environments. Due to powering the base station by hybrid renewable energy system, it will reduce the carbon and other harmful gases emission is about 90% in environments.

Acknowledgements

The authors acknowledge gratefully to Area Manager, BSNL-Bhopal for providing telecom base station data used in this study. The authors also thankful to the director Dr. K.S. Panday, Maulana Azad National Institute of Technology, Bhopal, for providing assistance to carry out the work at energy centre.

References

- [1] Ashok S. Optimized model for community based –Hybrid Energy systems. *Renewable Energy* 2007, 32(7), 1155-1164.
- [2] Katti K., Khedkar M.K. Alternative energy facilities based on site matching and generation unit sizing for remote area power supply. *Renewable Energy* 2007;32(2), 1346–1366.
- [3] Khan M.J., Iqbal M.T. Pre-feasibility study of stand-alone hybrid energy systems for applications in Newfoundland. *Renewable Energy* 2004, 30, 835-854.
- [4] Celik A.N. The system performance of autonomous photovoltaic–wind hybrid energy systems using synthetically generated weather data. *Renewable Energy* 2002, 27, 107–121.
- [5] Yang HX, Lu L, Burnett J. Weather data and probability analysis of hybrid photovoltaic–wind power generation systems in Hong Kong. *Renew Energy* 2003, 28(11), 1813–24.
- [6] Shaahid SM, Elhadidy MA. Opportunities for utilization of stand-alone hybrid (photovoltaic +diesel+battery) power systems in hot climates. *Renew Energy* 2003, 28 (11), 1741–53.
- [7] Elhadidy MA, Shaahid SM. Role of hybrid (wind + diesel) power systems in meeting commercial loads. *Renewable Energy* 2004, 29 (12), 109–18.
- [8] Pragma Nema, R. K. Nema , Saroj Rangnekar, Integrated Design approach for stand alone PV-solar and wind hybrid energy system: For Rural electrifications. International conference on advance energy systems (ICAER-2007) held at IIT Bombay, 12th-14th Dec.2007 pp.354-359.
- [9] Pragma Nema, R.K.Nema, Saroj Rangnekar March 17-18, 2007 ‘sizing and methodology of pv-solar/wind hybrid energy systems’ national conference of power electronics & intelligent control held at Malaviya National Institute of technology Jaipur (rajasthan), India. pp. no. 291-294
- [10] <http://www.motorola.com>
- [11] http://homepage.mac.com/unarte/solar_radiation.html
- [12] <http://www.energysolutionscenter.org>
- [13] <http://www.bergey.com/>
- [14] <http://nrel.gov/homer>
- [15] <http://eosweb.larc.nasa.gov/sse>

Pragma Nema - received her B.E. degree in Electrical Engineering from Govt. Engineering college of Sagar-M.P. in 1995. She received M.Tech. degree in Heavy Electrical Engineering from Maulana Azad College of Technology Bhopal-M.P.in 2001. She is currently pursuing Ph.D. degree at Maulana Azad National Institute of Technology Bhopal-India. Her current research interests include Integrated Renewable Energy System, Modeling and control of power systems.



R.K. Nema received his PhD degree in Electrical Engineering from Barkatullah University, Bhopal, India in 2004. He is currently Associate Professor at the Department of Electrical Engineering, Maulana Azad National Institute of Technology, Bhopal, India. His current research interest include power conditioning unit for Renewable Energy storage system particularly Solar Energy, Hybrid Energy Systems, Grid Interconnection of Renewable Energy sources.



Saroj Rangnekar is Professor in the Department of Energy, Energy Centre at Maulana Azad National Institute of Technology, Bhopal. Dr. Saroj Rangnekar has 32 years of teaching & research experience and received three National awards. She has published 85 papers in various International and National Journals, Conference proceedings. Her field of interest includes hydroelectric system, control systems and integrated renewable energy system, Modeling and optimization of the renewable energy sources.